Prime Core Dynamics
support@primecoredynamics.com

Louisiana, USA

COC# 145927
Lab # 214655
Date Rec'd 9/25/2026
Report Issued 10/8/2026

Certificate of Analysis



Project
Compound Glutathione
Label Claim 1500 mg
Batch/Lot GSH-1500MG-A01

Analyte	Result	Units	LOQ	% of Label	Method	Date	CAS
Peptides & Bioactives							
Chromatographic purity	>99.9	%	1		HPLC-UV/MS	9/29/2026	
Glutathione	1,710	mg	.1	114.3	HPLC-UV-MS	9/29/2026	70-18-8
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	9/29/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Data is not for regulatory compliance nor diagnostic use.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
OCH - above calibrated range OCL - below calibrated range
All values reported on a per vial basis unless otherwise noted
Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,


Mark C. Krause
Laboratory Director

****

CHROMATOGRAM

****

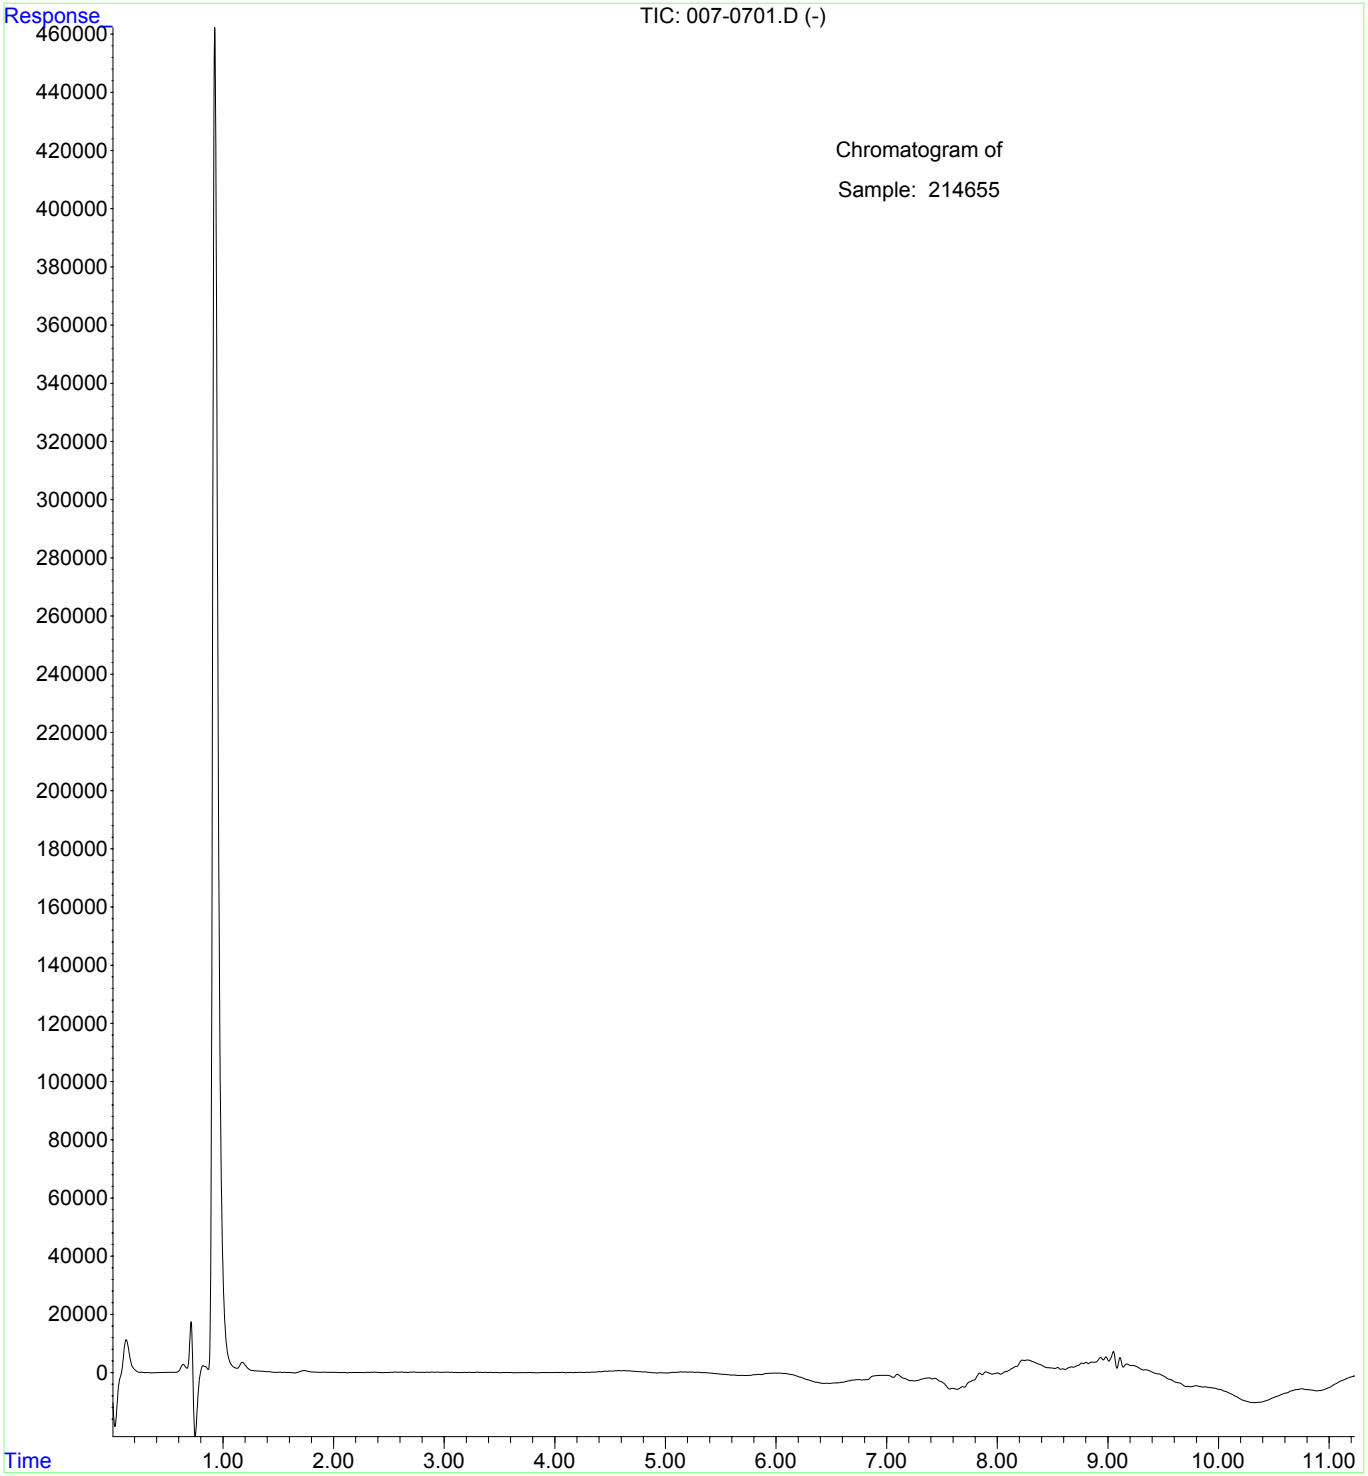

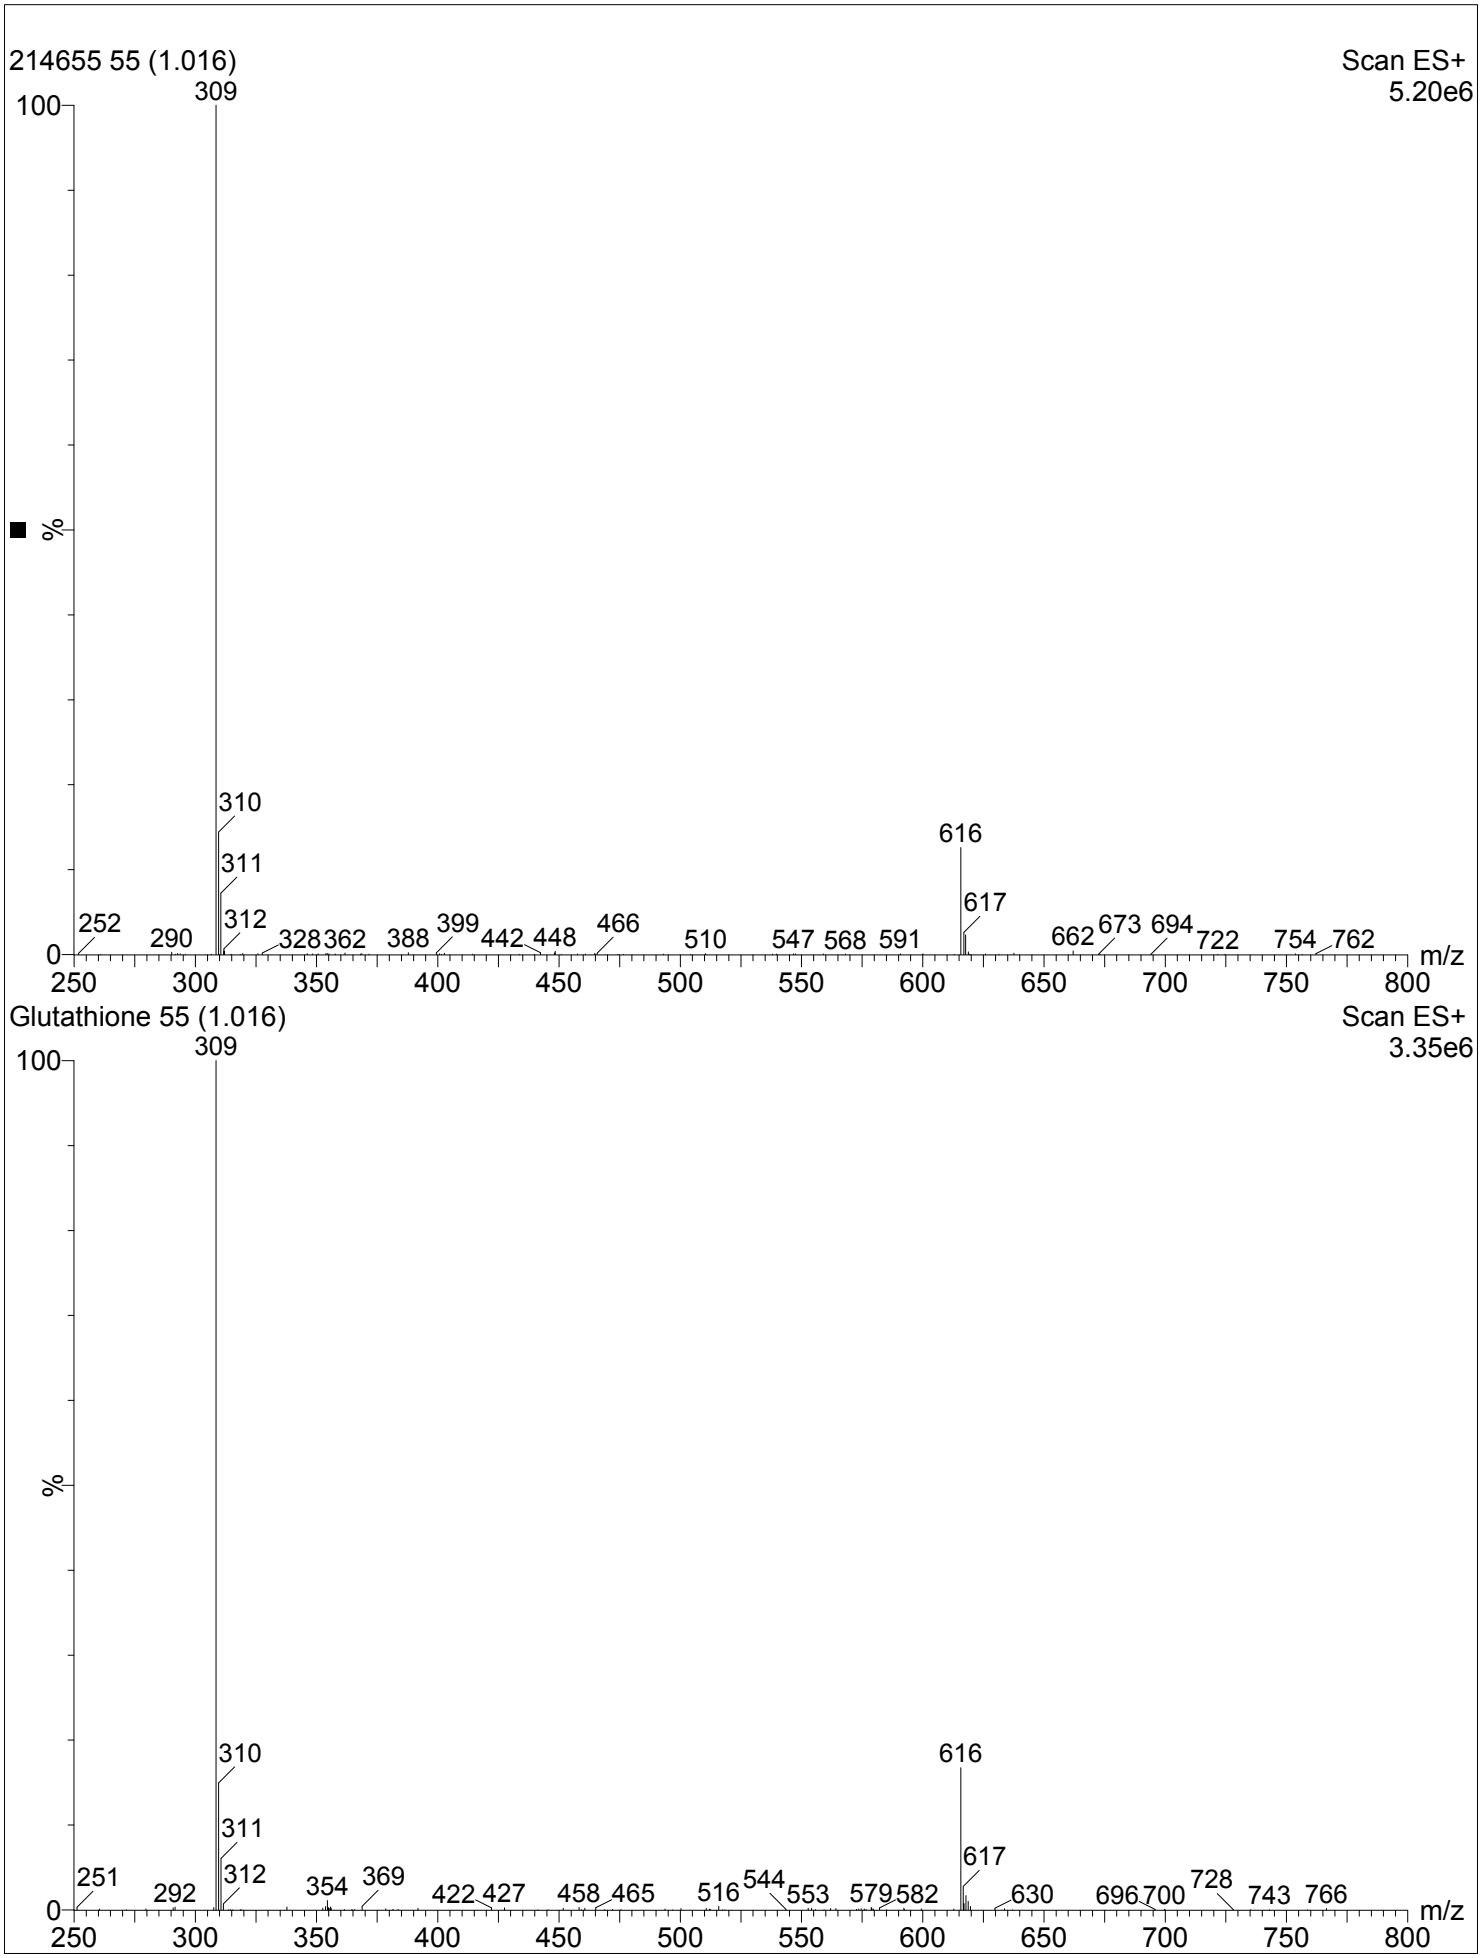
214655 55 (1.016)
Scan ES+
5.20e6
100
%
0
309
310
311
312
252
290
328
362
388
399
442
448
466
510
547
568
591
616
617
662
673
694
722
754
762
m/z
250
300
350
400
450
500
550
600
650
700
750
800
Glutathione 55 (1.016)
Scan ES+
3.35e6
100
%
0
309
310
311
312
251
292
354
369
422
427
458
465
516
544
553
579
582
616
617
630
696
700
728
743
766
m/z
250
300
350
400
450
500
550
600
650
700
750
800